


Project Name: _____
Job #: _____

ASTM A403, B16.9
CONCENTRIC REDUCERS

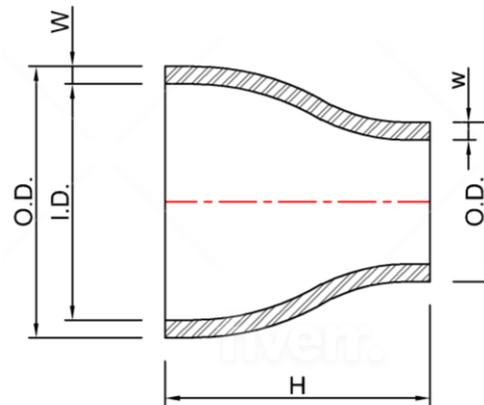

Grade: 304L 316L _____
Seam: Welded Seamless WPWX
Source: Import Domestic BAA AIS _____

DIMENSIONS

UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 5S <input type="checkbox"/> <- SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	¾ x ¾	1.050	0.675	1 ½	0.920	0.545	0.065	0.065	0.15
<input type="checkbox"/>	¾ x ½	1.050	0.840	1 ½	0.920	0.710	0.065	0.065	0.17
<input type="checkbox"/>	1 x ¾	1.315	0.675	2	1.185	0.545	0.065	0.065	0.16
<input type="checkbox"/>	1 x ½	1.315	0.840	2	1.185	0.710	0.065	0.065	0.16
<input type="checkbox"/>	1 x ¾	1.315	1.050	2	1.185	0.920	0.065	0.065	0.17
<input type="checkbox"/>	1 ¼ x ½	1.660	0.840	2	1.530	0.710	0.065	0.065	0.21
<input type="checkbox"/>	1 ¼ x ¾	1.660	1.050	2	1.530	0.920	0.065	0.065	0.22
<input type="checkbox"/>	1 ¼ x 1	1.660	1.315	2	1.530	1.185	0.065	0.065	0.22
<input type="checkbox"/>	1 ½ x ½	1.900	0.840	2 ½	1.770	0.710	0.065	0.065	0.23
<input type="checkbox"/>	1 ½ x ¾	1.900	1.050	2 ½	1.770	0.920	0.065	0.065	0.24
<input type="checkbox"/>	1 ½ x 1	1.900	1.315	2 ½	1.770	1.185	0.065	0.065	0.25
<input type="checkbox"/>	1 ½ x 1 ¼	1.900	1.660	2 ½	1.770	1.530	0.065	0.065	0.27
<input type="checkbox"/>	2 x ¾	2.375	1.050	3	2.245	0.920	0.065	0.065	0.33
<input type="checkbox"/>	2 x 1	2.375	1.315	3	2.245	1.185	0.065	0.065	0.37
<input type="checkbox"/>	2 x 1 ¼	2.375	1.660	3	2.245	1.530	0.065	0.065	0.40
<input type="checkbox"/>	2 x 1 ½	2.375	1.900	3	2.245	1.770	0.065	0.065	0.41
<input type="checkbox"/>	2 ½ x 1	2.875	1.315	3 ½	2.709	1.185	0.083	0.065	0.56
<input type="checkbox"/>	2 ½ x 1 ¼	2.875	1.660	3 ½	2.709	1.530	0.083	0.065	0.64
<input type="checkbox"/>	2 ½ x 1 ½	2.875	1.900	3 ½	2.709	1.770	0.083	0.065	0.67
<input type="checkbox"/>	2 ½ x 2	2.875	2.375	3 ½	2.709	2.245	0.083	0.065	0.70
<input type="checkbox"/>	3 x 1	3.500	1.315	3 ½	3.334	1.185	0.083	0.065	0.70
<input type="checkbox"/>	3 x 1 ¼	3.500	1.660	3 ½	3.334	1.530	0.083	0.065	0.70
<input type="checkbox"/>	3 x 1 ½	3.500	1.900	3 ½	3.334	1.770	0.083	0.065	0.78
<input type="checkbox"/>	3 x 2	3.500	2.375	3 ½	3.334	2.245	0.083	0.065	0.83
<input type="checkbox"/>	3 x 2 ½	3.500	2.875	3 ½	3.334	2.709	0.083	0.083	0.90
<input type="checkbox"/>	3 ½ x 1 ¼	4.000	1.660	4	3.834	1.530	0.083	0.065	0.93
<input type="checkbox"/>	3 ½ x 1 ½	4.000	1.900	4	3.834	1.770	0.083	0.065	0.99

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43

Project Name: _____


Job #: _____

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 5S <input type="checkbox"/> < SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	3 1/2 x 2	4.000	2.375	4	3.834	2.245	0.083	0.065	1.06
<input type="checkbox"/>	3 1/2 x 2 1/2	4.000	2.875	4	3.834	2.709	0.083	0.083	1.17
<input type="checkbox"/>	3 1/2 x 3	4.000	3.500	4	3.834	3.334	0.083	0.083	1.20
<input type="checkbox"/>	4 x 1 1/2	4.500	1.900	4	4.334	1.770	0.083	0.083	1.05
<input type="checkbox"/>	4 x 2	4.500	2.375	4	4.334	2.245	0.083	0.083	1.21
<input type="checkbox"/>	4 x 2 1/2	4.500	2.875	4	4.334	2.709	0.083	0.083	1.28
<input type="checkbox"/>	4 x 3	4.500	3.500	4	4.334	3.334	0.083	0.083	1.34
<input type="checkbox"/>	4 x 3 1/2	4.500	4.000	4	4.334	3.834	0.083	0.083	1.38
<input type="checkbox"/>	5 x 2	5.563	2.375	5	5.345	2.245	0.109	0.065	2.33
<input type="checkbox"/>	5 x 2 1/2	5.563	2.875	5	5.345	2.709	0.109	0.083	2.55
<input type="checkbox"/>	5 x 3	5.563	3.500	5	5.345	3.334	0.109	0.083	2.64
<input type="checkbox"/>	5 x 3 1/2	5.563	4.000	5	5.345	3.834	0.109	0.083	2.71
<input type="checkbox"/>	5 x 4	5.563	4.500	5	5.345	4.334	0.109	0.083	2.76
<input type="checkbox"/>	6 x 2 1/2	6.625	2.875	5 1/2	6.407	2.709	0.109	0.083	3.18
<input type="checkbox"/>	6 x 3	6.625	3.500	5 1/2	6.407	3.334	0.109	0.083	3.33
<input type="checkbox"/>	6 x 3 1/2	6.625	4.000	5 1/2	6.407	3.834	0.109	0.083	3.39
<input type="checkbox"/>	6 x 4	6.625	4.500	5 1/2	6.407	4.334	0.109	0.083	3.41
<input type="checkbox"/>	6 x 5	6.625	5.563	5 1/2	6.407	5.345	0.109	0.109	3.60
<input type="checkbox"/>	8 x 3 1/2	8.625	4.000	6	8.407	3.834	0.109	0.083	4.65
<input type="checkbox"/>	8 x 4	8.625	4.500	6	8.407	4.334	0.109	0.083	4.76
<input type="checkbox"/>	8 x 5	8.625	5.563	6	8.407	5.345	0.109	0.109	4.87
<input type="checkbox"/>	8 x 6	8.625	6.625	6	8.407	6.407	0.109	0.109	5.05
<input type="checkbox"/>	10 x 4	10.750	4.500	7	10.482	4.334	0.134	0.083	8.34
<input type="checkbox"/>	10 x 5	10.750	5.563	7	10.482	5.345	0.134	0.109	8.62
<input type="checkbox"/>	10 x 6	10.750	6.625	7	10.482	6.407	0.134	0.109	8.82
<input type="checkbox"/>	10 x 8	10.750	8.625	7	10.482	8.407	0.134	0.109	9.17
<input type="checkbox"/>	12 x 5	12.750	5.563	8	12.438	5.345	0.156	0.109	13.72
<input type="checkbox"/>	12 x 6	12.750	6.625	8	12.438	6.407	0.156	0.109	14.01
<input type="checkbox"/>	12 x 8	12.750	8.625	8	12.438	8.407	0.156	0.109	14.45
<input type="checkbox"/>	12 x 10	12.750	10.750	8	12.438	10.482	0.156	0.134	15.03
<input type="checkbox"/>	14 x 6	14.000	6.625	13	13.688	6.407	0.156	0.109	23.78
<input type="checkbox"/>	14 x 8	14.000	8.625	13	13.688	8.407	0.156	0.109	25.10
<input type="checkbox"/>	14 x 10	14.000	10.750	13	13.688	10.482	0.156	0.134	26.05
<input type="checkbox"/>	14 x 12	14.000	12.750	13	13.688	12.438	0.156	0.156	27.64
<input type="checkbox"/>	16 x 8	16.000	8.625	14	15.670	8.407	0.165	0.109	32.39
<input type="checkbox"/>	16 x 10	16.000	10.750	14	15.670	10.482	0.165	0.134	34.37
<input type="checkbox"/>	16 x 12	16.000	12.750	14	15.670	12.438	0.165	0.156	35.60
<input type="checkbox"/>	16 x 14	16.000	14.000	14	15.670	13.688	0.165	0.156	36.48
<input type="checkbox"/>	18 x 10	18.000	10.750	15	17.670	10.482	0.165	0.134	40.78
<input type="checkbox"/>	18 x 12	18.000	12.750	15	17.670	12.438	0.165	0.156	41.66
<input type="checkbox"/>	18 x 14	18.000	14.000	15	17.670	13.688	0.165	0.156	42.48
<input type="checkbox"/>	18 x 16	18.000	16.000	15	17.670	15.670	0.165	0.165	43.64
<input type="checkbox"/>	20 x 12	20.000	12.750	20	19.624	12.438	0.188	0.156	71.50
<input type="checkbox"/>	20 x 14	20.000	14.000	20	19.624	13.688	0.188	0.156	72.50
<input type="checkbox"/>	20 x 16	20.000	16.000	20	19.624	15.670	0.188	0.165	73.00
<input type="checkbox"/>	20 x 18	20.000	18.000	20	19.624	17.670	0.188	0.165	75.50
<input type="checkbox"/>	24 x 16	24.000	16.000	20	23.564	15.670	0.218	0.165	98.02
<input type="checkbox"/>	24 x 18	24.000	18.000	20	23.564	17.670	0.218	0.165	100.00
<input type="checkbox"/>	24 x 20	24.000	20.000	20	23.564	19.624	0.218	0.188	103.00

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(= Wall) & MSS SP-43

Project Name: _____
Job #: _____

ASTM A403, B16.9 CONCENTRIC REDUCERS

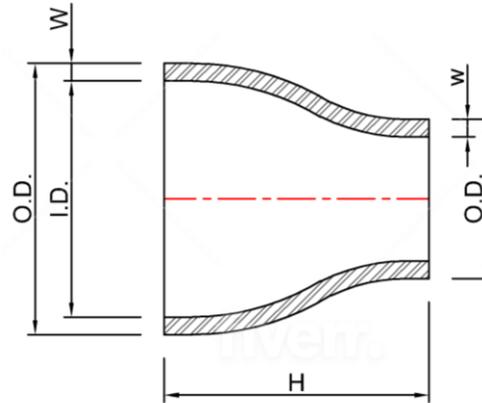

Grade: 304L 316L _____
Seam: Welded Seamless WPWX
Source: Import Domestic BAA AIS _____

DIMENSIONS


UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 10S <input type="checkbox"/> < SELECT				
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	Approx Weight
<input type="checkbox"/>	¾ x ¾	1.050	0.675	1 ½	0.884	0.545	0.083	0.065	0.20
<input type="checkbox"/>	¾ x ½	1.050	0.840	1 ½	0.884	0.674	0.083	0.083	0.22
<input type="checkbox"/>	1 x ¾	1.315	0.675	2	1.097	0.545	0.109	0.065	0.21
<input type="checkbox"/>	1 x ½	1.315	0.840	2	1.097	0.674	0.109	0.083	0.27
<input type="checkbox"/>	1 x ¾	1.315	1.050	2	1.097	0.884	0.109	0.083	0.29
<input type="checkbox"/>	1 ¼ x ½	1.660	0.840	2	1.442	0.674	0.109	0.083	0.35
<input type="checkbox"/>	1 ¼ x ¾	1.660	1.050	2	1.442	0.884	0.109	0.083	0.39
<input type="checkbox"/>	1 ¼ x 1	1.660	1.315	2	1.442	1.097	0.109	0.109	0.39
<input type="checkbox"/>	1 ½ x ½	1.900	0.840	2 ½	1.682	0.674	0.109	0.083	0.37
<input type="checkbox"/>	1 ½ x ¾	1.900	1.050	2 ½	1.682	0.884	0.109	0.083	0.39
<input type="checkbox"/>	1 ½ x 1	1.900	1.315	2 ½	1.682	1.097	0.109	0.109	0.43
<input type="checkbox"/>	1 ½ x 1 ¼	1.900	1.660	2 ½	1.682	1.442	0.109	0.109	0.46
<input type="checkbox"/>	2 x ¾	2.375	1.050	3	2.157	0.884	0.109	0.083	0.56
<input type="checkbox"/>	2 x 1	2.375	1.315	3	2.157	1.097	0.109	0.109	0.62
<input type="checkbox"/>	2 x 1 ¼	2.375	1.660	3	2.157	1.442	0.109	0.109	0.67
<input type="checkbox"/>	2 x 1 ½	2.375	1.900	3	2.157	1.682	0.109	0.109	0.69
<input type="checkbox"/>	2 ½ x 1	2.875	1.315	3 ½	2.635	1.097	0.120	0.109	0.83
<input type="checkbox"/>	2 ½ x 1 ¼	2.875	1.660	3 ½	2.635	1.442	0.120	0.109	0.95
<input type="checkbox"/>	2 ½ x 1 ½	2.875	1.900	3 ½	2.635	1.682	0.120	0.109	0.98
<input type="checkbox"/>	2 ½ x 2	2.875	2.375	3 ½	2.635	2.157	0.120	0.109	1.03
<input type="checkbox"/>	3 x 1	3.500	1.315	3 ½	3.260	1.097	0.120	0.109	1.03
<input type="checkbox"/>	3 x 1 ¼	3.500	1.660	3 ½	3.260	1.442	0.120	0.109	1.03
<input type="checkbox"/>	3 x 1 ½	3.500	1.900	3 ½	3.260	1.682	0.120	0.109	1.13
<input type="checkbox"/>	3 x 2	3.500	2.375	3 ½	3.260	2.157	0.120	0.109	1.21
<input type="checkbox"/>	3 x 2 ½	3.500	2.875	3 ½	3.260	2.635	0.120	0.120	1.30
<input type="checkbox"/>	3 ½ x 1 ¼	4.000	1.660	4	3.760	1.442	0.120	0.109	1.37
<input type="checkbox"/>	3 ½ x 1 ½	4.000	1.900	4	3.760	1.682	0.120	0.109	1.46

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43

Project Name: _____
Job #: _____

ASTM A403, B16.9
CONCENTRIC REDUCERS

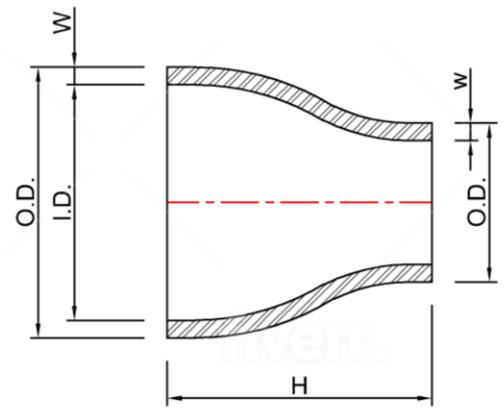

Grade: 304L 316L _____
 Seam: Welded Seamless WPWX
 Source: Import Domestic BAA AIS _____

DIMENSIONS

UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 40S <input type="checkbox"/> <- SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	3/4 x 3/8	1.050	0.675	1 1/2	0.824	0.493	0.113	0.091	0.27
<input type="checkbox"/>	3/4 x 1/2	1.050	0.840	1 1/2	0.824	0.622	0.113	0.109	0.31
<input type="checkbox"/>	1 x 3/8	1.315	0.675	2	1.049	0.493	0.133	0.091	0.33
<input type="checkbox"/>	1 x 1/2	1.315	0.840	2	1.049	0.622	0.133	0.109	0.34
<input type="checkbox"/>	1 x 3/4	1.315	1.050	2	1.049	0.824	0.133	0.113	0.36
<input type="checkbox"/>	1 1/4 x 1/2	1.660	0.840	2	1.380	0.622	0.140	0.109	0.46
<input type="checkbox"/>	1 1/4 x 3/4	1.660	1.050	2	1.380	0.824	0.140	0.113	0.49
<input type="checkbox"/>	1 1/4 x 1	1.660	1.315	2	1.380	1.049	0.140	0.133	0.49
<input type="checkbox"/>	1 1/2 x 1/2	1.900	0.840	2 1/2	1.610	0.622	0.145	0.109	0.50
<input type="checkbox"/>	1 1/2 x 3/4	1.900	1.050	2 1/2	1.610	0.824	0.145	0.113	0.52
<input type="checkbox"/>	1 1/2 x 1	1.900	1.315	2 1/2	1.610	1.049	0.145	0.133	0.28
<input type="checkbox"/>	1 1/2 x 1 1/4	1.900	1.660	2 1/2	1.610	1.380	0.145	0.140	0.62
<input type="checkbox"/>	2 x 3/4	2.375	1.050	3	2.067	0.824	0.154	0.113	0.80
<input type="checkbox"/>	2 x 1	2.375	1.315	3	2.067	1.049	0.154	0.133	0.89
<input type="checkbox"/>	2 x 1 1/4	2.375	1.660	3	2.067	1.380	0.154	0.140	0.96
<input type="checkbox"/>	2 x 1 1/2	2.375	1.900	3	2.067	1.610	0.154	0.145	0.99
<input type="checkbox"/>	2 1/2 x 1	2.875	1.315	3 1/2	2.469	1.049	0.203	0.133	1.42
<input type="checkbox"/>	2 1/2 x 1 1/4	2.875	1.660	3 1/2	2.469	1.380	0.203	0.140	1.61
<input type="checkbox"/>	2 1/2 x 1 1/2	2.875	1.900	3 1/2	2.469	1.610	0.203	0.145	1.67
<input type="checkbox"/>	2 1/2 x 2	2.875	2.375	3 1/2	2.469	2.067	0.203	0.154	1.76
<input type="checkbox"/>	3 x 1	3.500	1.315	3 1/2	3.068	1.049	0.216	0.133	1.81
<input type="checkbox"/>	3 x 1 1/4	3.500	1.660	3 1/2	3.068	1.380	0.216	0.140	1.86
<input type="checkbox"/>	3 x 1 1/2	3.500	1.900	3 1/2	3.068	1.610	0.216	0.145	2.07
<input type="checkbox"/>	3 x 2	3.500	2.375	3 1/2	3.068	2.067	0.216	0.154	2.20
<input type="checkbox"/>	3 x 2 1/2	3.500	2.875	3 1/2	3.068	2.469	0.216	0.203	2.38
<input type="checkbox"/>	3 1/2 x 1 1/4	4.000	1.660	4	3.548	1.380	0.226	0.140	2.60
<input type="checkbox"/>	3 1/2 x 1 1/2	4.000	1.900	4	3.548	1.610	0.226	0.145	2.76

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43




SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 40S ■ < SELECT				
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	Approx Weight
<input type="checkbox"/>	3 ½ x 2	4.000	2.375	4	3.548	2.067	0.226	0.154	2.97
<input type="checkbox"/>	3 ½ x 2 ½	4.000	2.875	4	3.548	2.469	0.226	0.203	3.25
<input type="checkbox"/>	3 ½ x 3	4.000	3.500	4	3.548	3.068	0.226	0.216	3.35
<input type="checkbox"/>	4 x 1 ½	4.500	1.900	4	4.026	1.610	0.237	0.145	3.00
<input type="checkbox"/>	4 x 2	4.500	2.375	4	4.026	2.067	0.237	0.154	3.47
<input type="checkbox"/>	4 x 2 ½	4.500	2.875	4	4.026	2.469	0.237	0.203	3.66
<input type="checkbox"/>	4 x 3	4.500	3.500	4	4.026	3.068	0.237	0.216	3.84
<input type="checkbox"/>	4 x 3 ½	4.500	4.000	4	4.026	3.548	0.237	0.226	3.97
<input type="checkbox"/>	5 x 2	5.563	2.375	5	5.047	2.067	0.258	0.154	5.55
<input type="checkbox"/>	5 x 2 ½	5.563	2.875	5	5.047	2.469	0.258	0.203	6.07
<input type="checkbox"/>	5 x 3	5.563	3.500	5	5.047	3.068	0.258	0.216	6.29
<input type="checkbox"/>	5 x 3 ½	5.563	4.000	5	5.047	3.548	0.258	0.226	6.45
<input type="checkbox"/>	5 x 4	5.563	4.500	5	5.047	4.026	0.258	0.237	6.57
<input type="checkbox"/>	6 x 2 ½	6.625	2.875	5 ½	6.065	2.469	0.280	0.203	8.37
<input type="checkbox"/>	6 x 3	6.625	3.500	5 ½	6.065	3.068	0.280	0.216	8.77
<input type="checkbox"/>	6 x 3 ½	6.625	4.000	5 ½	6.065	3.548	0.280	0.226	8.93
<input type="checkbox"/>	6 x 4	6.625	4.500	5 ½	6.065	4.026	0.280	0.237	8.99
<input type="checkbox"/>	6 x 5	6.625	5.563	5 ½	6.065	5.047	0.280	0.258	9.48
<input type="checkbox"/>	8 x 3 ½	8.625	4.000	6	7.981	3.548	0.322	0.226	14.10
<input type="checkbox"/>	8 x 4	8.625	4.500	6	7.981	4.026	0.322	0.237	14.44
<input type="checkbox"/>	8 x 5	8.625	5.563	6	7.981	5.047	0.322	0.258	14.78
<input type="checkbox"/>	8 x 6	8.625	6.625	6	7.981	6.065	0.322	0.280	15.31
<input type="checkbox"/>	10 x 4	10.750	4.500	7	10.020	4.026	0.365	0.237	23.19
<input type="checkbox"/>	10 x 5	10.750	5.563	7	10.020	5.047	0.365	0.258	23.96
<input type="checkbox"/>	10 x 6	10.750	6.625	7	10.020	6.065	0.365	0.280	24.52
<input type="checkbox"/>	10 x 8	10.750	8.625	7	10.020	7.981	0.365	0.322	25.48
<input type="checkbox"/>	12 x 5	12.750	5.563	8	12.000	5.047	0.375	0.258	33.48
<input type="checkbox"/>	12 x 6	12.750	6.625	8	12.000	6.065	0.375	0.280	34.13
<input type="checkbox"/>	12 x 8	12.750	8.625	8	12.000	7.981	0.375	0.322	35.24
<input type="checkbox"/>	12 x 10	12.750	10.750	8	12.000	10.020	0.375	0.365	36.67
<input type="checkbox"/>	14 x 6	14.000	6.625	13	13.250	6.065	0.375	0.280	58.00
<input type="checkbox"/>	14 x 8	14.000	8.625	13	13.250	7.981	0.375	0.322	61.22
<input type="checkbox"/>	14 x 10	14.000	10.750	13	13.250	10.020	0.375	0.365	63.55
<input type="checkbox"/>	14 x 12	14.000	12.750	13	13.250	12.000	0.375	0.375	67.42
<input type="checkbox"/>	16 x 8	16.000	8.625	14	15.250	7.981	0.375	0.322	73.6
<input type="checkbox"/>	16 x 10	16.000	10.750	14	15.250	10.020	0.375	0.365	78.12
<input type="checkbox"/>	16 x 12	16.000	12.750	14	15.250	12.000	0.375	0.375	80.91
<input type="checkbox"/>	16 x 14	16.000	14.000	14	15.250	13.250	0.375	0.375	82.92
<input type="checkbox"/>	18 x 10	18.000	10.750	15	17.250	10.020	0.375	0.365	92.69
<input type="checkbox"/>	18 x 12	18.000	12.750	15	17.250	12.000	0.375	0.375	94.70
<input type="checkbox"/>	18 x 14	18.000	14.000	15	17.250	13.250	0.375	0.375	96.56
<input type="checkbox"/>	18 x 16	18.000	16.000	15	17.250	15.250	0.375	0.375	99.20
<input type="checkbox"/>	20 x 12	20.000	12.750	20	19.250	12.000	0.375	0.375	143.00
<input type="checkbox"/>	20 x 14	20.000	14.000	20	19.250	13.250	0.375	0.375	145.00
<input type="checkbox"/>	20 x 16	20.000	16.000	20	19.250	15.250	0.375	0.375	146.00
<input type="checkbox"/>	20 x 18	20.000	18.000	20	19.250	17.250	0.375	0.375	151.00
<input type="checkbox"/>	24 x 16	24.000	16.000	20	23.250	15.250	0.375	0.375	169.00
<input type="checkbox"/>	24 x 18	24.000	18.000	20	23.250	17.250	0.375	0.375	173.00
<input type="checkbox"/>	24 x 20	24.000	20.000	20	23.250	19.250	0.375	0.375	179.00

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(= Wall) & MSS SP-43

Project Name: _____

Job #: _____

ASTM A403, B16.9 CONCENTRIC REDUCERS

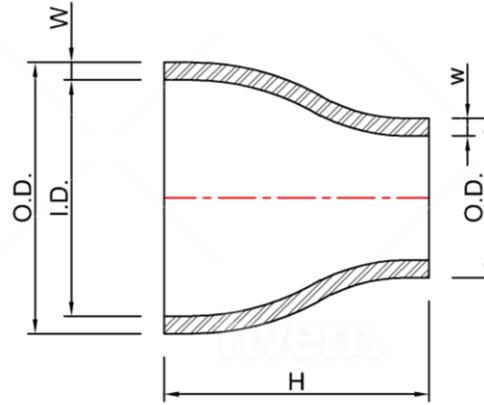

Grade: 304L 316L _____
 Seam: Welded Seamless WPWX
 Source: Import Domestic BAA AIS _____

DIMENSIONS

UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 80S <input type="checkbox"/> < SELECT				
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	Approx Weight
<input type="checkbox"/>	¾ x ¾	1.050	0.675	1 ½	0.742	0.423	0.154	0.126	0.37
<input type="checkbox"/>	¾ x ½	1.050	0.840	1 ½	0.742	0.546	0.154	0.147	0.40
<input type="checkbox"/>	1 x ¾	1.315	0.675	2	0.957	0.423	0.179	0.126	0.42
<input type="checkbox"/>	1 x ½	1.315	0.840	2	0.957	0.546	0.179	0.147	0.44
<input type="checkbox"/>	1 x ¾	1.315	1.050	2	0.957	0.742	0.179	0.154	0.49
<input type="checkbox"/>	1 ¼ x ½	1.660	0.840	2	1.278	0.546	0.191	0.147	0.52
<input type="checkbox"/>	1 ¼ x ¾	1.660	1.050	2	1.278	0.742	0.191	0.154	0.56
<input type="checkbox"/>	1 ¼ x 1	1.660	1.315	2	1.278	0.957	0.191	0.179	0.59
<input type="checkbox"/>	1 ½ x ½	1.900	0.840	2 ½	1.500	0.546	0.200	0.147	0.68
<input type="checkbox"/>	1 ½ x ¾	1.900	1.050	2 ½	1.500	0.742	0.200	0.154	0.71
<input type="checkbox"/>	1 ½ x 1	1.900	1.315	2 ½	1.500	0.957	0.200	0.179	0.74
<input type="checkbox"/>	1 ½ x 1 ¼	1.900	1.660	2 ½	1.500	1.278	0.200	0.191	0.80
<input type="checkbox"/>	2 x ¾	2.375	1.050	3	1.939	0.742	0.218	0.154	1.11
<input type="checkbox"/>	2 x 1	2.375	1.315	3	1.939	0.957	0.218	0.179	1.18
<input type="checkbox"/>	2 x 1 ¼	2.375	1.660	3	1.939	1.278	0.218	0.191	1.27
<input type="checkbox"/>	2 x 1 ½	2.375	1.900	3	1.939	1.500	0.218	0.200	1.30
<input type="checkbox"/>	2 ½ x 1	2.875	1.315	3 ½	2.323	0.957	0.276	0.179	1.92
<input type="checkbox"/>	2 ½ x 1 ¼	2.875	1.660	3 ½	2.323	1.278	0.276	0.191	1.98
<input type="checkbox"/>	2 ½ x 1 ½	2.875	1.900	3 ½	2.323	1.500	0.276	0.200	2.07
<input type="checkbox"/>	2 ½ x 2	2.875	2.375	3 ½	2.323	1.939	0.276	0.218	2.26
<input type="checkbox"/>	3 x 1	3.500	1.315	3 ½	2.900	0.957	0.300	0.179	2.39
<input type="checkbox"/>	3 x 1 ¼	3.500	1.660	3 ½	2.900	1.278	0.300	0.191	2.51
<input type="checkbox"/>	3 x 1 ½	3.500	1.900	3 ½	2.900	1.500	0.300	0.200	2.66
<input type="checkbox"/>	3 x 2	3.500	2.375	3 ½	2.900	1.939	0.300	0.218	2.85
<input type="checkbox"/>	3 x 2 ½	3.500	2.875	3 ½	2.900	2.323	0.300	0.276	3.28
<input type="checkbox"/>	3 ½ x 1 ¼	4.000	1.660	4	3.364	1.278	0.318	0.191	3.53
<input type="checkbox"/>	3 ½ x 1 ½	4.000	1.900	4	3.364	1.500	0.318	0.200	3.69


ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 80S <input type="checkbox"/> < SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	3 1/2 x 2	4.000	2.375	4	3.364	2.323	0.318	0.276	3.87
<input type="checkbox"/>	3 1/2 x 2 1/2	4.000	2.875	4	3.364	2.900	0.318	0.300	4.21
<input type="checkbox"/>	3 1/2 x 3	4.000	3.500	4	3.826	1.500	0.337	0.200	4.46
<input type="checkbox"/>	4 x 1 1/2	4.500	1.900	4	3.826	1.939	0.337	0.218	4.18
<input type="checkbox"/>	4 x 2	4.500	2.375	4	3.826	2.323	0.337	0.276	4.31
<input type="checkbox"/>	4 x 2 1/2	4.500	2.875	4	3.826	2.900	0.337	0.300	4.83
<input type="checkbox"/>	4 x 3	4.500	3.500	4	3.826	3.364	0.337	0.318	5.14
<input type="checkbox"/>	4 x 3 1/2	4.500	4.000	4	4.813	1.939	0.375	0.337	5.33
<input type="checkbox"/>	5 x 2	5.563	2.375	5	4.813	2.323	0.375	0.276	7.25
<input type="checkbox"/>	5 x 2 1/2	5.563	2.875	5	4.813	2.900	0.375	0.300	7.93
<input type="checkbox"/>	5 x 3	5.563	3.500	5	4.813	3.364	0.375	0.318	8.55
<input type="checkbox"/>	5 x 3 1/2	5.563	4.000	5	4.813	3.826	0.375	0.337	8.80
<input type="checkbox"/>	5 x 4	5.563	4.500	5	5.761	2.323	0.432	0.276	9.11
<input type="checkbox"/>	6 x 2 1/2	6.625	2.875	5 1/2	5.761	2.900	0.432	0.300	10.88
<input type="checkbox"/>	6 x 3	6.625	3.500	5 1/2	5.761	3.364	0.432	0.318	12.15
<input type="checkbox"/>	6 x 3 1/2	6.625	4.000	5 1/2	5.761	3.826	0.432	0.337	12.67
<input type="checkbox"/>	6 x 4	6.625	4.500	5 1/2	5.761	4.813	0.432	0.375	13.14
<input type="checkbox"/>	6 x 5	6.625	5.563	5 1/2	3.364	2.323	0.318	0.276	13.79
<input type="checkbox"/>	8 x 3 1/2	8.625	4.000	6	7.625	3.364	0.500	0.318	17.61
<input type="checkbox"/>	8 x 4	8.625	4.500	6	7.625	3.826	0.500	0.337	20.36
<input type="checkbox"/>	8 x 5	8.625	5.563	6	7.625	4.813	0.500	0.375	21.32
<input type="checkbox"/>	8 x 6	8.625	6.625	6	7.625	5.761	0.500	0.432	22.32
<input type="checkbox"/>	10 x 4	10.750	4.500	7	9.750	3.826	0.500	0.337	27.68
<input type="checkbox"/>	10 x 5	10.750	5.563	7	9.750	4.813	0.500	0.375	31.40
<input type="checkbox"/>	10 x 6	10.750	6.625	7	9.750	5.761	0.500	0.432	32.61
<input type="checkbox"/>	10 x 8	10.750	8.625	7	9.750	7.625	0.500	0.500	34.34
<input type="checkbox"/>	12 x 5	12.750	5.563	8	11.750	4.813	0.500	0.375	42.78
<input type="checkbox"/>	12 x 6	12.750	6.625	8	11.750	5.761	0.500	0.432	44.42
<input type="checkbox"/>	12 x 8	12.750	8.625	8	11.750	7.625	0.500	0.500	46.06
<input type="checkbox"/>	12 x 10	12.750	10.750	8	11.750	9.750	0.500	0.500	47.70
<input type="checkbox"/>	14 x 6	14.000	6.625	13	13.000	5.761	0.500	0.432	77.81
<input type="checkbox"/>	14 x 8	14.000	8.625	13	13.000	7.625	0.500	0.500	81.22
<input type="checkbox"/>	14 x 10	14.000	10.750	13	13.000	9.750	0.500	0.500	85.40
<input type="checkbox"/>	14 x 12	14.000	12.750	13	13.000	11.750	0.500	0.500	88.97
<input type="checkbox"/>	16 x 8	16.000	8.625	14	15.000	7.625	0.500	0.500	97.49
<input type="checkbox"/>	16 x 10	16.000	10.750	14	15.000	9.750	0.500	0.500	102.00
<input type="checkbox"/>	16 x 12	16.000	12.750	14	15.000	11.750	0.500	0.500	105.00
<input type="checkbox"/>	16 x 14	16.000	14.000	14	15.000	13.000	0.500	0.500	108.00
<input type="checkbox"/>	18 x 10	18.000	10.750	15	17.000	9.750	0.500	0.500	120.00
<input type="checkbox"/>	18 x 12	18.000	12.750	15	17.000	11.750	0.500	0.500	126.00
<input type="checkbox"/>	18 x 14	18.000	14.000	15	17.000	13.000	0.500	0.500	127.00
<input type="checkbox"/>	18 x 16	18.000	16.000	15	17.000	15.000	0.500	0.500	130.00
<input type="checkbox"/>	20 x 12	20.000	12.750	20	19.000	11.750	0.500	0.500	189.00
<input type="checkbox"/>	20 x 14	20.000	14.000	20	19.000	13.000	0.500	0.500	192.00
<input type="checkbox"/>	20 x 16	20.000	16.000	20	19.000	15.000	0.500	0.500	195.00
<input type="checkbox"/>	20 x 18	20.000	18.000	20	19.000	17.000	0.500	0.500	198.00
<input type="checkbox"/>	24 x 16	24.000	16.000	20	23.000	15.000	0.500	0.500	226.00
<input type="checkbox"/>	24 x 18	24.000	18.000	20	23.000	17.000	0.500	0.500	230.00
<input type="checkbox"/>	24 x 20	24.000	20.000	20	23.000	19.000	0.500	0.500	234.00

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(= Wall) & MSS SP-43

Project Name: _____
Job #: _____

ASTM A403, B16.9 CONCENTRIC REDUCERS

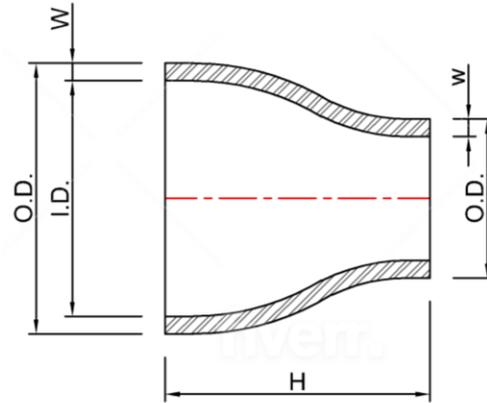

Grade: 304L 316L _____
Seam: Welded Seamless WPWX
Source: Import Domestic BAA AIS _____

DIMENSIONS

UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 160S <input type="checkbox"/> <- SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	¾ x ¾	1.050	0.675	1 ½	-----	-----	-----	-----	-----
<input type="checkbox"/>	¾ x ½	1.050	0.840	1 ½	0.612	0.466	0.219	0.187	0.55
<input type="checkbox"/>	1 x ¾	1.315	0.675	2	-----	-----	-----	-----	-----
<input type="checkbox"/>	1 x ½	1.315	0.840	2	0.815	0.466	0.250	0.187	0.57
<input type="checkbox"/>	1 x ¾	1.315	1.050	2	0.815	0.614	0.250	0.218	0.61
<input type="checkbox"/>	1 ¼ x ½	1.660	0.840	2	1.160	0.466	0.250	0.187	0.67
<input type="checkbox"/>	1 ¼ x ¾	1.660	1.050	2	1.160	0.614	0.250	0.218	0.73
<input type="checkbox"/>	1 ¼ x 1	1.660	1.315	2	1.160	0.815	0.250	0.250	0.82
<input type="checkbox"/>	1 ½ x ½	1.900	0.840	2 ½	1.338	0.466	0.281	0.187	0.95
<input type="checkbox"/>	1 ½ x ¾	1.900	1.050	2 ½	1.338	0.614	0.281	0.218	0.99
<input type="checkbox"/>	1 ½ x 1	1.900	1.315	2 ½	1.338	0.815	0.281	0.250	1.03
<input type="checkbox"/>	1 ½ x 1 ¼	1.900	1.660	2 ½	1.338	1.160	0.281	0.250	1.12
<input type="checkbox"/>	2 x ¾	2.375	1.050	3	1.689	0.614	0.343	0.218	1.74
<input type="checkbox"/>	2 x 1	2.375	1.315	3	1.689	0.815	0.343	0.250	1.85
<input type="checkbox"/>	2 x 1 ¼	2.375	1.660	3	1.689	1.160	0.343	0.250	1.99
<input type="checkbox"/>	2 x 1 ½	2.375	1.900	3	1.689	1.338	0.343	0.281	2.04
<input type="checkbox"/>	2 ½ x 1	2.875	1.315	3 ½	2.125	0.815	0.375	0.250	2.59
<input type="checkbox"/>	2 ½ x 1 ¼	2.875	1.660	3 ½	2.125	1.160	0.375	0.250	2.67
<input type="checkbox"/>	2 ½ x 1 ½	2.875	1.900	3 ½	2.125	1.338	0.375	0.281	2.79
<input type="checkbox"/>	2 ½ x 2	2.875	2.375	3 ½	2.125	1.689	0.375	0.343	3.05
<input type="checkbox"/>	3 x 1	3.500	1.315	3 ½	2.624	0.815	0.438	0.250	3.32
<input type="checkbox"/>	3 x 1 ¼	3.500	1.660	3 ½	2.624	1.160	0.438	0.250	3.63
<input type="checkbox"/>	3 x 1 ½	3.500	1.900	3 ½	2.624	1.338	0.438	0.281	3.85
<input type="checkbox"/>	3 x 2	3.500	2.375	3 ½	2.624	1.689	0.438	0.343	4.13
<input type="checkbox"/>	3 x 2 ½	3.500	2.875	3 ½	2.624	2.125	0.438	0.375	4.75
<input type="checkbox"/>	3 ½ x 1 ¼	4.000	1.660	4	-----	-----	-----	-----	-----
<input type="checkbox"/>	3 ½ x 1 ½	4.000	1.900	4	-----	-----	-----	-----	-----


ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	SCHEDULE 160S ◼ <- SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	3 ½ x 2	4.000	2.375	4	----	----	----	----	----
<input type="checkbox"/>	3 ½ x 2 ½	4.000	2.875	4	----	----	----	----	----
<input type="checkbox"/>	3 ½ x 3	4.000	3.500	4	----	----	----	----	----
<input type="checkbox"/>	4 x 1 ½	4.500	1.900	4	3.438	1.338	0.531	0.281	6.56
<input type="checkbox"/>	4 x 2	4.500	2.375	4	3.438	1.689	0.531	0.343	6.76
<input type="checkbox"/>	4 x 2 ½	4.500	2.875	4	3.438	2.125	0.531	0.375	7.58
<input type="checkbox"/>	4 x 3	4.500	3.500	4	3.438	2.624	0.531	0.438	8.07
<input type="checkbox"/>	4 x 3 ½	4.500	4.000	4	----	----	----	----	----
<input type="checkbox"/>	5 x 2	5.563	2.375	5	4.313	1.689	0.625	0.343	12.03
<input type="checkbox"/>	5 x 2 ½	5.563	2.875	5	4.313	2.125	0.625	0.375	13.16
<input type="checkbox"/>	5 x 3	5.563	3.500	5	4.313	2.624	0.625	0.438	14.19
<input type="checkbox"/>	5 x 3 ½	5.563	4.000	5	----	----	----	----	----
<input type="checkbox"/>	5 x 4	5.563	4.500	5	4.313	3.438	0.625	0.531	15.12
<input type="checkbox"/>	6 x 2 ½	6.625	2.875	5 ½	5.187	2.125	0.719	0.375	18.06
<input type="checkbox"/>	6 x 3	6.625	3.500	5 ½	5.187	2.624	0.719	0.438	20.17
<input type="checkbox"/>	6 x 3 ½	6.625	4.000	5 ½	----	----	----	----	----
<input type="checkbox"/>	6 x 4	6.625	4.500	5 ½	5.187	3.438	0.719	0.531	21.81
<input type="checkbox"/>	6 x 5	6.625	5.563	5 ½	5.187	4.313	0.719	0.625	22.89
<input type="checkbox"/>	8 x 3 ½	8.625	4.000	6	----	----	----	----	----
<input type="checkbox"/>	8 x 4	8.625	4.500	6	6.813	3.438	0.906	0.531	36.85
<input type="checkbox"/>	8 x 5	8.625	5.563	6	6.813	4.313	0.906	0.625	38.50
<input type="checkbox"/>	8 x 6	8.625	6.625	6	6.813	5.187	0.906	0.719	40.30
<input type="checkbox"/>	10 x 4	10.750	4.500	7	8.500	3.438	1.125	0.531	62.30
<input type="checkbox"/>	10 x 5	10.750	5.563	7	8.500	4.313	1.125	0.625	70.60
<input type="checkbox"/>	10 x 6	10.750	6.625	7	8.500	5.187	1.125	0.719	73.30
<input type="checkbox"/>	10 x 8	10.750	8.625	7	8.500	6.813	1.125	0.906	77.10
<input type="checkbox"/>	12 x 5	12.750	5.563	8	10.126	4.313	1.312	0.625	112.00
<input type="checkbox"/>	12 x 6	12.750	6.625	8	10.126	5.187	1.312	0.719	116.00
<input type="checkbox"/>	12 x 8	12.750	8.625	8	10.126	6.813	1.312	0.906	120.00
<input type="checkbox"/>	12 x 10	12.750	10.750	8	10.126	8.500	1.312	1.125	124.00
<input type="checkbox"/>	14 x 6	14.000	6.625	13	11.188	5.187	1.406	0.719	----
<input type="checkbox"/>	14 x 8	14.000	8.625	13	11.188	6.813	1.406	0.906	----
<input type="checkbox"/>	14 x 10	14.000	10.750	13	11.188	8.500	1.406	1.125	----
<input type="checkbox"/>	14 x 12	14.000	12.750	13	11.188	10.126	1.406	1.312	----
<input type="checkbox"/>	16 x 8	16.000	8.625	14	12.812	6.813	1.594	0.906	----
<input type="checkbox"/>	16 x 10	16.000	10.750	14	12.812	8.500	1.594	1.125	----
<input type="checkbox"/>	16 x 12	16.000	12.750	14	12.812	10.126	1.594	1.312	----
<input type="checkbox"/>	16 x 14	16.000	14.000	14	12.812	11.188	1.594	1.406	----
<input type="checkbox"/>	18 x 10	18.000	10.750	15	14.438	8.500	1.781	1.125	----
<input type="checkbox"/>	18 x 12	18.000	12.750	15	14.438	10.126	1.781	1.312	----
<input type="checkbox"/>	18 x 14	18.000	14.000	15	14.438	11.188	1.781	1.406	----
<input type="checkbox"/>	18 x 16	18.000	16.000	15	14.438	12.812	1.781	1.594	----
<input type="checkbox"/>	20 x 12	20.000	12.750	20	19.624	16.062	10.126	1.969	----
<input type="checkbox"/>	20 x 14	20.000	14.000	20	19.624	16.062	11.188	1.969	----
<input type="checkbox"/>	20 x 16	20.000	16.000	20	19.624	16.062	12.812	1.969	----
<input type="checkbox"/>	20 x 18	20.000	18.000	20	19.624	16.062	14.438	1.969	----
<input type="checkbox"/>	24 x 16	24.000	16.000	20	23.564	19.312	12.812	2.344	----
<input type="checkbox"/>	24 x 18	24.000	18.000	20	23.564	19.312	14.438	2.344	----
<input type="checkbox"/>	24 x 20	24.000	20.000	20	23.564	19.312	16.062	2.344	----

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(= Wall) & MSS SP-43

Project Name: _____
Job #: _____

ASTM A403, B16.9
CONCENTRIC REDUCERS

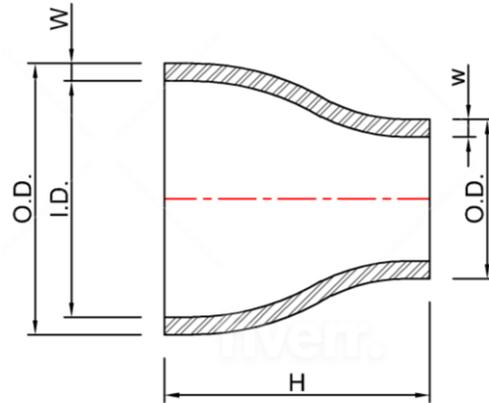

Grade: 304L 316L _____
Seam: Welded Seamless WPWX
Source: Import Domestic BAA AIS _____

DIMENSIONS

UOM: Inches/LBS

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	XX STRONG WALL <input type="checkbox"/> < SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	¾ x ¾	1.050	0.675	1 ½	-----	-----	-----	-----	-----
<input type="checkbox"/>	¾ x ½	1.050	0.840	1 ½	0.434	0.252	0.308	0.294	0.80
<input type="checkbox"/>	1 x ¾	1.315	0.675	2	-----	-----	-----	-----	-----
<input type="checkbox"/>	1 x ½	1.315	0.840	2	0.599	0.252	0.358	0.294	0.88
<input type="checkbox"/>	1 x ¾	1.315	1.050	2	0.599	0.434	0.358	0.308	0.98
<input type="checkbox"/>	1 ¼ x ½	1.660	0.840	2	0.896	0.252	0.382	0.294	1.04
<input type="checkbox"/>	1 ¼ x ¾	1.660	1.050	2	0.896	0.434	0.382	0.308	1.12
<input type="checkbox"/>	1 ¼ x 1	1.660	1.315	2	0.896	0.599	0.382	0.358	1.18
<input type="checkbox"/>	1 ½ x ½	1.900	0.840	2 ½	1.100	0.252	0.400	0.294	1.36
<input type="checkbox"/>	1 ½ x ¾	1.900	1.050	2 ½	1.100	0.434	0.400	0.308	1.42
<input type="checkbox"/>	1 ½ x 1	1.900	1.315	2 ½	1.100	0.599	0.400	0.358	1.48
<input type="checkbox"/>	1 ½ x 1 ¼	1.900	1.660	2 ½	1.100	0.896	0.400	0.382	1.60
<input type="checkbox"/>	2 x ¾	2.375	1.050	3	1.503	0.434	0.436	0.308	2.22
<input type="checkbox"/>	2 x 1	2.375	1.315	3	1.503	0.599	0.436	0.358	2.36
<input type="checkbox"/>	2 x 1 ¼	2.375	1.660	3	1.503	0.896	0.436	0.382	2.54
<input type="checkbox"/>	2 x 1 ½	2.375	1.900	3	1.503	1.110	0.436	0.400	2.60
<input type="checkbox"/>	2 ½ x 1	2.875	1.315	3 ½	1.771	0.599	0.552	0.358	3.84
<input type="checkbox"/>	2 ½ x 1 ¼	2.875	1.660	3 ½	1.771	0.896	0.552	0.382	3.96
<input type="checkbox"/>	2 ½ x 1 ½	2.875	1.900	3 ½	1.771	1.110	0.552	0.400	4.14
<input type="checkbox"/>	2 ½ x 2	2.875	2.375	3 ½	1.771	1.503	0.552	0.436	4.52
<input type="checkbox"/>	3 x 1	3.500	1.315	3 ½	2.300	0.599	0.600	0.358	4.76
<input type="checkbox"/>	3 x 1 ¼	3.500	1.660	3 ½	2.300	0.896	0.600	0.382	5.02
<input type="checkbox"/>	3 x 1 ½	3.500	1.900	3 ½	2.300	1.110	0.600	0.400	5.23
<input type="checkbox"/>	3 x 2	3.500	2.375	3 ½	2.300	1.503	0.600	0.436	5.70
<input type="checkbox"/>	3 x 2 ½	3.500	2.875	3 ½	2.300	1.771	0.600	0.552	6.56
<input type="checkbox"/>	3 ½ x 1 ¼	4.000	1.660	4	2.728	0.896	0.636	0.382	7.06
<input type="checkbox"/>	3 ½ x 1 ½	4.000	1.900	4	2.728	1.100	0.636	0.400	7.38

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(≠ Wall) & MSS SP-43

SELECT	NOMINAL PIPE SIZE Large End x Small End	OUTSIDE DIAMETER LARGE END (O.D.)	OUTSIDE DIAMETER SMALL END (O.D.)	LENGTH (L)	XX STRONG WALL <input type="checkbox"/> < SELECT				Approx Weight
					Inside Diameter Large End (I.D.)	Inside Diameter Small End (I.D.)	Wall Thickness Large End (W)	Wall Thickness Small End (w)	
<input type="checkbox"/>	3 1/2 x 2	4.000	2.375	4	2.728	1.771	0.636	0.552	7.74
<input type="checkbox"/>	3 1/2 x 2 1/2	4.000	2.875	4	2.728	2.300	0.636	0.600	8.42
<input type="checkbox"/>	3 1/2 x 3	4.000	3.500	4	3.152	1.100	0.674	0.400	8.92
<input type="checkbox"/>	4 x 1 1/2	4.500	1.900	4	3.152	1.503	0.674	0.436	8.36
<input type="checkbox"/>	4 x 2	4.500	2.375	4	3.152	1.771	0.674	0.552	8.62
<input type="checkbox"/>	4 x 2 1/2	4.500	2.875	4	3.152	2.300	0.674	0.600	9.66
<input type="checkbox"/>	4 x 3	4.500	3.500	4	3.152	2.728	0.674	0.636	10.28
<input type="checkbox"/>	4 x 3 1/2	4.500	4.000	4	4.063	1.503	0.750	0.436	10.66
<input type="checkbox"/>	5 x 2	5.563	2.375	5	4.063	1.771	0.750	0.552	14.50
<input type="checkbox"/>	5 x 2 1/2	5.563	2.875	5	4.063	2.300	0.750	0.600	15.86
<input type="checkbox"/>	5 x 3	5.563	3.500	5	4.063	2.728	0.750	0.636	17.10
<input type="checkbox"/>	5 x 3 1/2	5.563	4.000	5	4.063	3.152	0.750	0.674	17.60
<input type="checkbox"/>	5 x 4	5.563	4.500	5	4.897	1.771	0.864	0.552	18.22
<input type="checkbox"/>	6 x 2 1/2	6.625	2.875	5 1/2	4.897	2.300	0.864	0.600	21.76
<input type="checkbox"/>	6 x 3	6.625	3.500	5 1/2	4.897	2.728	0.864	0.636	24.30
<input type="checkbox"/>	6 x 3 1/2	6.625	4.000	5 1/2	4.897	3.152	0.864	0.674	25.34
<input type="checkbox"/>	6 x 4	6.625	4.500	5 1/2	4.897	4.063	0.864	0.750	26.28
<input type="checkbox"/>	6 x 5	6.625	5.563	5 1/2	2.728	1.771	0.636	0.552	27.58
<input type="checkbox"/>	8 x 3 1/2	8.625	4.000	6	6.875	2.728	0.875	0.636	30.81
<input type="checkbox"/>	8 x 4	8.625	4.500	6	6.875	3.152	0.875	0.674	35.63
<input type="checkbox"/>	8 x 5	8.625	5.563	6	6.875	4.063	0.875	0.750	37.31
<input type="checkbox"/>	8 x 6	8.625	6.625	6	6.875	4.897	0.875	0.864	39.06
<input type="checkbox"/>	10 x 4	10.750	4.500	7	-----	-----	-----	-----	-----
<input type="checkbox"/>	10 x 5	10.750	5.563	7	-----	-----	-----	-----	-----
<input type="checkbox"/>	10 x 6	10.750	6.625	7	-----	-----	-----	-----	-----
<input type="checkbox"/>	10 x 8	10.750	8.625	7	-----	-----	-----	-----	-----
<input type="checkbox"/>	12 x 5	12.750	5.563	8	-----	-----	-----	-----	-----
<input type="checkbox"/>	12 x 6	12.750	6.625	8	-----	-----	-----	-----	-----
<input type="checkbox"/>	12 x 8	12.750	8.625	8	-----	-----	-----	-----	-----
<input type="checkbox"/>	12 x 10	12.750	10.750	8	-----	-----	-----	-----	-----
<input type="checkbox"/>	14 x 6	14.000	6.625	13	-----	-----	-----	-----	-----
<input type="checkbox"/>	14 x 8	14.000	8.625	13	-----	-----	-----	-----	-----
<input type="checkbox"/>	14 x 10	14.000	10.750	13	-----	-----	-----	-----	-----
<input type="checkbox"/>	14 x 12	14.000	12.750	13	-----	-----	-----	-----	-----
<input type="checkbox"/>	16 x 8	16.000	8.625	14	-----	-----	-----	-----	-----
<input type="checkbox"/>	16 x 10	16.000	10.750	14	-----	-----	-----	-----	-----
<input type="checkbox"/>	16 x 12	16.000	12.750	14	-----	-----	-----	-----	-----
<input type="checkbox"/>	16 x 14	16.000	14.000	14	-----	-----	-----	-----	-----
<input type="checkbox"/>	18 x 10	18.000	10.750	15	-----	-----	-----	-----	-----
<input type="checkbox"/>	18 x 12	18.000	12.750	15	-----	-----	-----	-----	-----
<input type="checkbox"/>	18 x 14	18.000	14.000	15	-----	-----	-----	-----	-----
<input type="checkbox"/>	18 x 16	18.000	16.000	15	-----	-----	-----	-----	-----
<input type="checkbox"/>	20 x 12	20.000	12.750	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	20 x 14	20.000	14.000	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	20 x 16	20.000	16.000	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	20 x 18	20.000	18.000	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	24 x 16	24.000	16.000	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	24 x 18	24.000	18.000	20	-----	-----	-----	-----	-----
<input type="checkbox"/>	24 x 20	24.000	20.000	20	-----	-----	-----	-----	-----

ss wld ftg and pipe conform to ASTM A403 & MSS SP-43; dimensionally, all ftg conform to ASME B16.9
(= Wall) & MSS SP-43